


Broadys NZ Ltd Central Heating

Open Vent Low Pressure HWC
•Single Heating Coil

Typical Pipe Run Specs:
NB: Must Be All Fully Insulated (lagged)
Bends must be "swept"
Radiators piped in pairs

Boiler Flow/Return – 25mm
To Radiators Flow/Return – 20mm
Radiator connection risers – 15mm
In/Out of Panels – 15mm

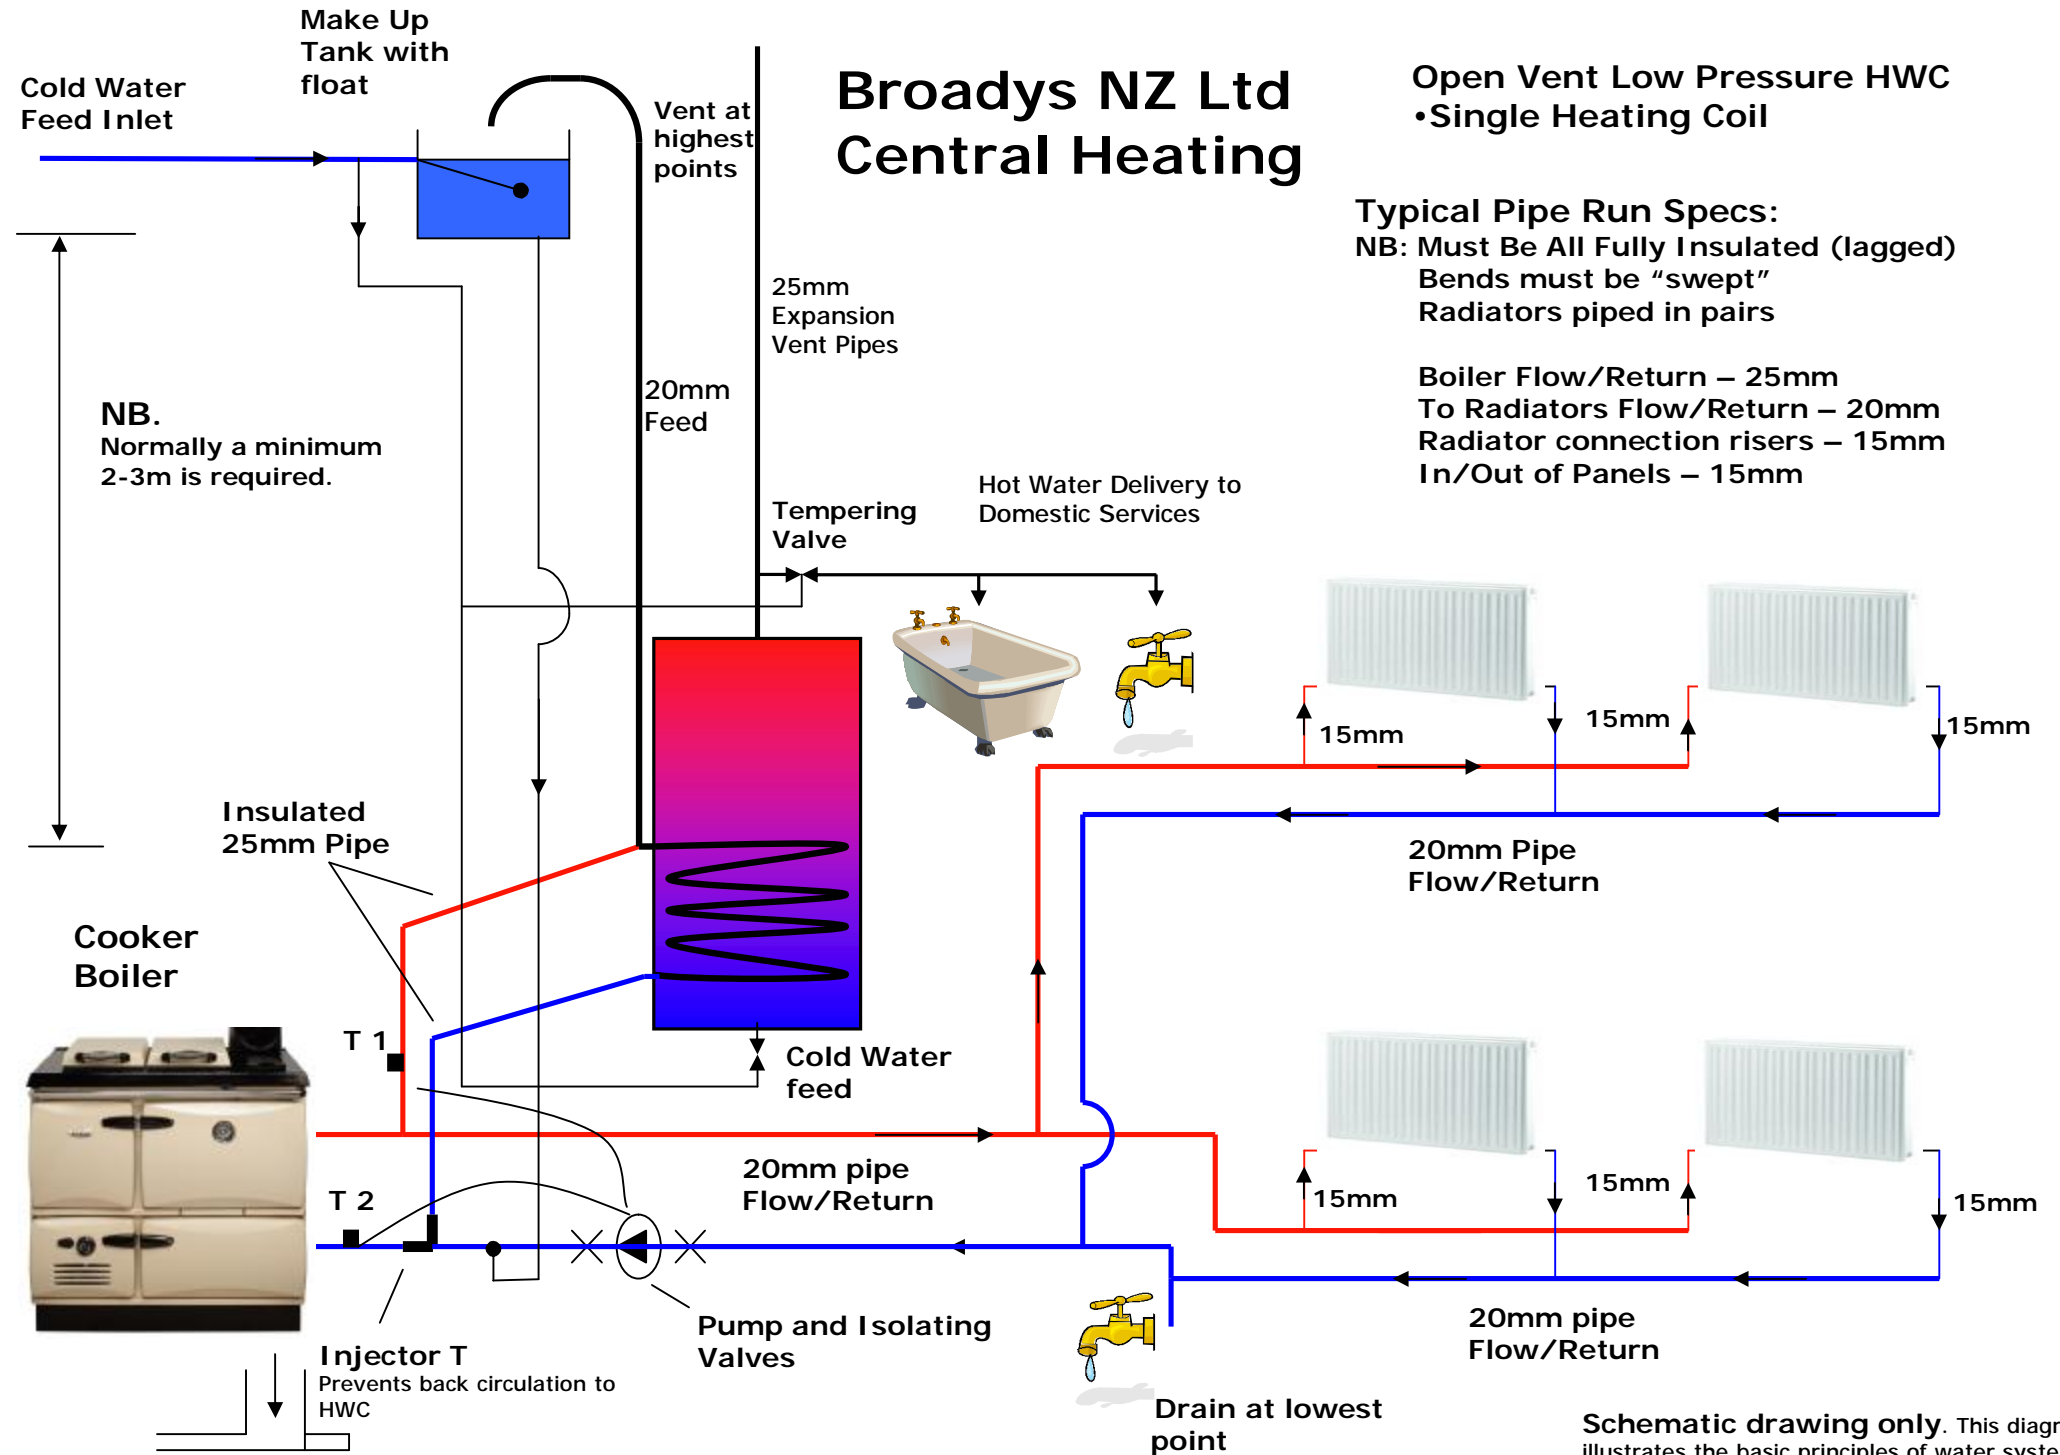

NB. Normally a minimum 2-3m is required.

Schematic drawing only. This diagram illustrates the basic principles of water systems